

## Perspective

The promise of coupling geologic CO<sub>2</sub> storage with sedimentary basin geothermal power generationJeffrey M. Bielicki,<sup>1,2</sup> Martina Leveni,<sup>1</sup> Jeremiah X. Johnson,<sup>3,\*</sup> and Brian R. Ellis<sup>4</sup>

## SUMMARY

**Achieving ambitious greenhouse gas mitigation targets will require technological advances and cost reductions in dispatchable carbon-free power generation sources that can provide load following flexibility to integrate high penetrations of variable wind and solar power. Several other sectors may be difficult to decarbonize and a net-zero or net-negative carbon economy may require the deployment of geologic carbon dioxide (CO<sub>2</sub>) storage. Utilizing CO<sub>2</sub> as a working fluid for geothermal energy production and energy storage can achieve both goals: isolating CO<sub>2</sub> from the atmosphere and providing valuable power system services to enable high penetrations of variable carbon-free electricity production. The use of CO<sub>2</sub> as a working fluid facilitates access to low-grade heat in sedimentary basins, which are widely available and could allow for strategic siting near CO<sub>2</sub> sources or where power system flexibility is needed. In this perspective piece, we summarize the state of knowledge for sedimentary basin CO<sub>2</sub>-geothermal, sometimes referred to as CO<sub>2</sub> plume geothermal, and explore how it could support decarbonization of the energy sector. We also present the potential for using geologically stored CO<sub>2</sub> for bulk energy storage which could provide valuable time-shifting and other services to the power grid. We explore the promise and challenges of these technologies, identify key research gaps, and offer a critical appraisal of the role that policy for a technology at the intersection of renewable energy, energy storage, and geologic CO<sub>2</sub> storage may play in achieving broad deployment.**

**THERE IS A NEED FOR DISPATCHABLE CARBON-FREE POWER AND GEOLOGIC CO<sub>2</sub> STORAGE TO ACHIEVE DEEP DECARBONIZATION**

Anthropogenic emissions of greenhouse gases—most notably CO<sub>2</sub>—are accelerating global climate change (IPCC et al., 2021). The negative environmental, economic, and social effects of climate change have motivated substantial efforts to decarbonize economies. Many pathways to achieve deep reductions in greenhouse gas emissions require the power sector to drastically reduce CO<sub>2</sub> emissions while simultaneously electrifying other sectors, such as transportation and heating (Krey et al., 2014; Williams et al., 2012; National Academies of Science, Engineering and Medicine, 2021; Jenkins et al., 2018). Decarbonization of the power sector can occur through a transition to less carbon-intensive fuels (e.g., from coal to natural gas), the displacement of fossil fuels (e.g., from coal to nuclear), the rapid increase in deployment and utilization of renewable energy (e.g., more use of wind, solar, and geothermal), and broad implementation of geologic CO<sub>2</sub> storage (GCS).

Although wind and solar power have become increasingly cost effective, (U.S. DOE EIA, 2021) high penetrations of variable wind and solar energy capacity can pose grid integration challenges and result in the curtailment of these carbon-free generation sources and diminishing reductions in net CO<sub>2</sub> emissions (Denholm et al., 2015; Arbabzadeh et al., 2019; Das et al., 2020). Figure 1 illustrates these challenges, with multi-day periods of high wind generation followed by periods of low wind output (Southwest Power Pool), and diurnal patterns of solar generation balanced by increasing imports and natural gas generation during the off-peak hours (California Independent System Operator). In both regions, there are time intervals where carbon-free generation exceeds 75% of total generation, and other periods where this share drops to 20%. The challenges posed by integrating variable wind and solar can be addressed with the

<sup>1</sup>Department of Civil, Environmental, and Geodetic Engineering, the Ohio State University, Columbus, OH, USA


<sup>2</sup>John Glenn College of Public Affairs, the Ohio State University, Columbus, OH, USA

<sup>3</sup>Department of Civil, Construction, and Environmental Engineering, North Carolina State University, Raleigh, NC, USA

<sup>4</sup>Department of Civil and Environmental Engineering, University of Michigan, Ann Arbor, MI, USA

\*Correspondence: [jjohns24@ncsu.edu](mailto:jjohns24@ncsu.edu)  
<https://doi.org/10.1016/j.isci.2022.105618>



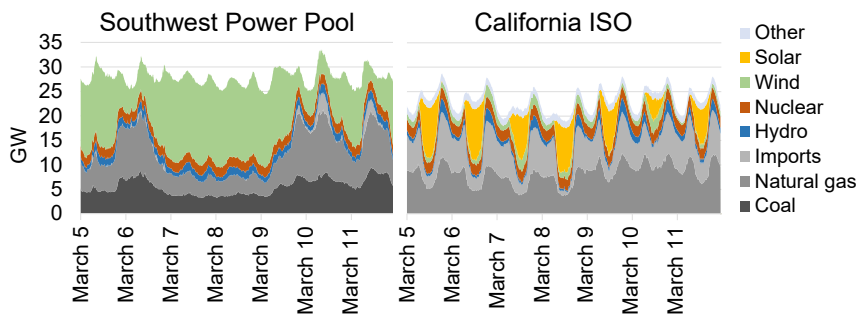

**Figure 1. Generation mix for one week of March 2020 in two regions of the United States, showcasing the need for flexible, dispatchable carbon-free generation sources**

The Southwest Power Pool is a wind-rich area that spans the central farmlands, and the California Independent System Operator serves much of the most populated US state and leads in solar-generated electricity.

addition of energy storage, expanded transmission capacity, and increased grid flexibility (Jenkins et al., 2018; Braff et al., 2016).


The addition of *flexible* carbon-free generation sources could enable deeper levels of decarbonization on grids that are challenged by high penetrations of wind and solar capacity. (Sepulveda et al., 2018) These flexible sources could include load-following renewables to balance generation variability, as well as short- and long-duration energy storage that can accommodate wind and solar generation that would otherwise be curtailed and provide power during extended periods of low wind and solar output. Beyond the power sector, several other major sources of emissions, such as cement and steel manufacturing, may be difficult to decarbonize and a net-zero carbon economy may be cost-effectively achieved with deployment of GCS (Davis et al., 2018). Although economic challenges remain in scaling up GCS, coupling GCS with flexible geothermal electricity production and energy storage could serve both goals of providing grid flexibility and isolating CO<sub>2</sub> from the atmosphere.

### SEDIMENTARY BASIN CO<sub>2</sub>-ENABLED GEOTHERMAL UTILIZATION: THE STATE OF THE TECHNOLOGY

Deep saline aquifers in sedimentary basins have been widely investigated for GCS – which is an essential element of almost all least-cost pathways for decarbonization (Jenkins et al., 2018). This permanent isolation of CO<sub>2</sub> from the atmosphere at depths greater than 800 m below the surface is also a crucial component of the major “negative emissions” technologies that extract CO<sub>2</sub> directly from the atmosphere (i.e., direct air CO<sub>2</sub> capture and bioenergy CO<sub>2</sub> capture and storage). At present, there are 65 geologic CO<sub>2</sub> storage projects worldwide, of which 26 are operating, and 40 MtCO<sub>2</sub>/yr are being stored.<sup>13</sup> (Global CCS Institute, 2020).

If the CO<sub>2</sub> is emplaced in an aquifer within a sedimentary basin geothermal resource, it may be possible to circulate a portion of the geologically stored CO<sub>2</sub> in a closed system between the subsurface and the surface to produce thermal energy. The goal of GCS is to store the CO<sub>2</sub> in the subsurface to isolate it from the atmosphere, but the CO<sub>2</sub> does not necessarily need to always be in the GCS reservoir. The geologically stored CO<sub>2</sub> could be used as the geothermal heat extraction fluid and the heat could be used directly or converted to electricity in a geothermal power plant, before reinjecting the CO<sub>2</sub> into the subsurface. In this way, a CO<sub>2</sub>-driven geothermal power plant may be added to a GCS site, or prospective site assessment could consider the utility for both CO<sub>2</sub> storage and geothermal heat extraction.

The use of CO<sub>2</sub> for geothermal heat extraction was originally proposed for geothermal systems that were hot but did not contain water (steam) or did not have sufficient permeability to sustain water-based heat extraction (Brown, 2000). With the enormous heat resource in deep hot dry rocks (HDR), where the geothermal temperature gradient can be 60°C/km or greater, the idea was to create an enhanced geothermal system (EGS) to tap extremely low intrinsic permeability by artificial stimulation techniques – much like hydraulic fracturing for unconventional oil and gas production from tight shale reservoirs (Tester et al., 2006). Such stimulation can engender concerns about triggering earthquakes and limit deployment

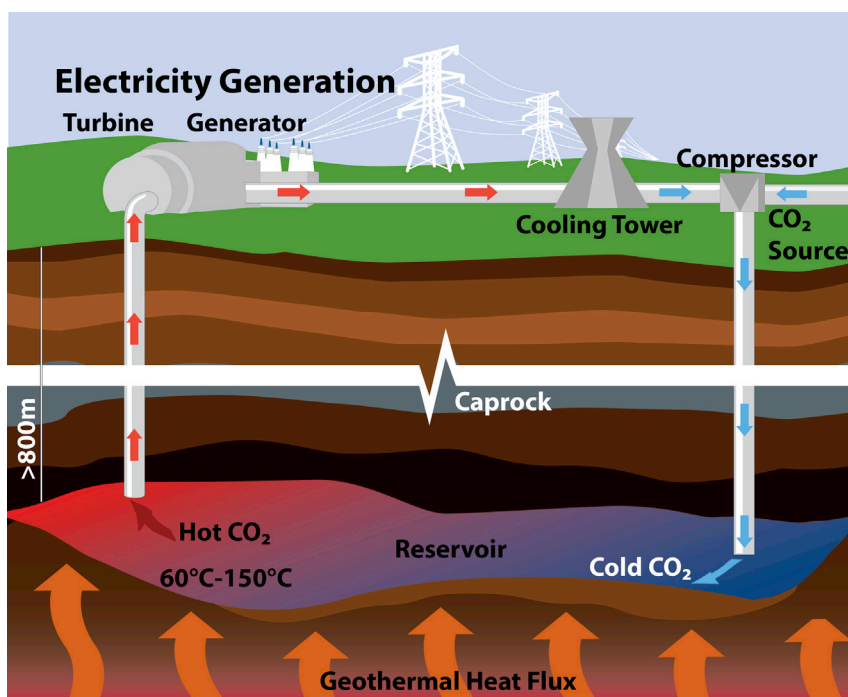


**Figure 2.** Sedimentary basin CO<sub>2</sub>-enabled geothermal utilization system

(Breede et al., 2013; Schultz et al., 2020; Majer et al., 2007). In contrast, the deep aquifers in sedimentary basins that are targeted for GCS are naturally porous and permeable, which may facilitate sufficient fluid flowrates and capacities. These basins do not require the level of stimulation that HDR systems for EGS need, and are relatively ubiquitous worldwide (IPCC et al., 2005).

Sedimentary basin geothermal resources typically have lower temperatures (60–150°C) than potential HDR resources or the dominant, albeit limited, resources used for existing geothermal power development—hydrothermal settings with faulted and fractured systems with high heat flow and natural or artificial fluid recharge. In part due to the lower temperatures, sedimentary basin geothermal resources have not been studied as much as HDR or conventional hydrothermal resources (U.S. DOE, 2019). Available resource estimates for the contiguous United States alone are enormous; the median estimate is 800 million TWh for depths shallower than 3 km<sup>20</sup>(U.S. DOE, 2019), which is several orders of magnitude larger than the US energy system. Because US basins may be representative of basins worldwide (Deng et al., 2017), the resource base is unlikely to be a limiting factor.

In the aquifers in these basins that are to be used for CO<sub>2</sub> storage, the temperatures and pressures are above the critical point of CO<sub>2</sub> (31.1°C, 7.4 MPa), which causes the CO<sub>2</sub> to be in a supercritical phase (i.e., having the density of a liquid and the viscosity of a gas). Compared to the native brine, CO<sub>2</sub> has a higher mobility at reservoir conditions, which more than compensates for its lower specific heat if it were to be used as a working fluid for heat extraction. Further, the density of CO<sub>2</sub> is highly temperature-dependent and, despite Joule-Thomson cooling as the CO<sub>2</sub> ascends in the production well (Pan et al., 2015), a self-convecting thermosiphon can develop between the cool (more dense) CO<sub>2</sub> in the injection well and the hot (less dense) CO<sub>2</sub> in the production well (Atrens et al., 2009; Adams et al., 2014). Although not necessary for CO<sub>2</sub>-driven geothermal heat extraction (Adams et al., 2021a), this thermosiphon can provide a meaningful contribution to flow rates, heat extraction, and electricity generation (Adams et al., 2014; Atrens et al., 2010) if some considerations (e.g., thermally insulated wells) are addressed (Pan et al., 2018).

As illustrated in Figure 2, the hot CO<sub>2</sub> that is produced from the reservoir can be used to generate electricity. This hot CO<sub>2</sub> can be expanded in a turbine to generate electricity (direct system) or its heat

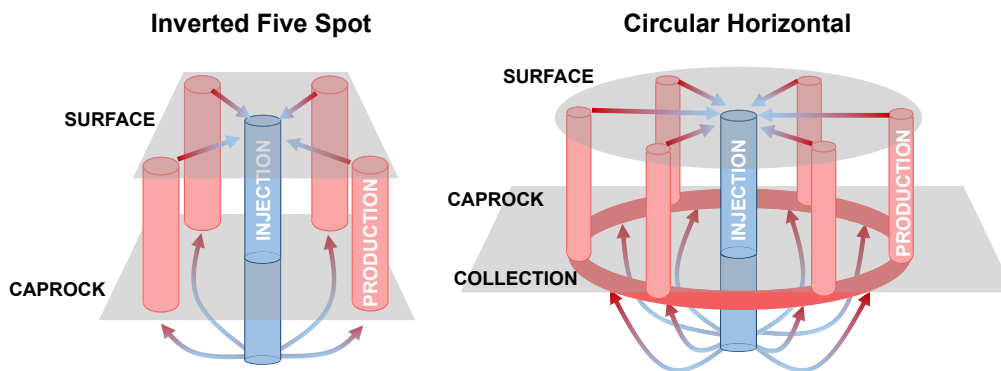

**Figure 3. Two well pattern options for CO<sub>2</sub>-enabled geothermal utilization: inverted five-spot and circular horizontal**

transferred to a secondary fluid such as R254fa or CO<sub>2</sub> (indirect system). (Adams et al., 2015) This work, which couples power cycle, wellbore, and reservoir models, has shown the advantage of CO<sub>2</sub> over brine as the geothermal heat extraction fluid decreases with deeper reservoirs; CO<sub>2</sub> is preferred in 1 km deep reservoirs whereas brine is preferred in 5 km deep reservoirs, and the switchover point depends on reservoir conditions (e.g., geothermal temperature gradient). For indirect systems, subcritical, superheated, and supercritical organic Rankine cycles have been investigated (Wang et al., 2019). These systems have been integrated with auxiliary heat sources, including waste heat and solar energy (Garapati et al., 2020; Qiao et al., 2020). In both direct and indirect systems, a pump may be used to supplement the thermosiphon effect and enable sufficient flow rates. Other options to use CO<sub>2</sub> as a geothermal heat extraction fluid include integration with natural gas recovery (Ezekiel et al., 2020), which can have financial benefits but the net climate benefits need to be assessed, or implementation in depleted natural gas reservoirs, but higher residual brine saturations may lead to salt precipitation and inhibit the effectiveness of using CO<sub>2</sub> as a working fluid (Cui et al., 2021a).

Effective geothermal heat mining is essential to this approach. Geothermal power plants in hydrothermal resources may deplete the heat resource over time, as heat extraction exceeds the heat recharge by the geothermal heat flux, and can resort to additional strategies like injecting water to add pressure to the system (U.S. DOE EERE, 2021). The typical lifetime for geothermal power plants is on the order of a few decades and not much different from capital associated with other types of renewable and nonrenewable electricity-generating capacity. In the context of sedimentary basin CO<sub>2</sub>-geothermal, in which conduction is the primary mode of heat transfer, (SedHeat, 2013) reservoir management may have added importance. Residual CO<sub>2</sub> trapping (which is a goal of GCS) must be accommodated while preserving sufficient CO<sub>2</sub> flow for heat extraction in the subsurface. Brine production for active CO<sub>2</sub> reservoir management (Buscheck et al., 2012), which typically manages reservoir pressure for GCS, could pull the CO<sub>2</sub> plume toward the production well to reduce the time until the produced fluid is predominantly CO<sub>2</sub>. One modeling study suggests that the produced fluid must be at least 93% CO<sub>2</sub> for the use of CO<sub>2</sub> to be effective for geothermal heat mining (Garapati et al., 2015). In the operational phase, sedimentary basin CO<sub>2</sub>-geothermal is contingent on the active management of injection and production flow rates, which implies management of heat extraction. Given the low-temperature (for geothermal systems) sedimentary resources, it could be preferable to use the CO<sub>2</sub>-geothermal facility as a dispatchable resource (e.g., to firm variable wind and solar generation), as opposed to baseload operations that would deplete the heat too quickly. Attempting to optimally place and size wells—the choices of which will depend on the reservoir depth, temperature, thickness, permeability, and well configuration (Adams et al., 2021b)—can help facilitate effective geothermal heat mining and minimize water upconing in the production well (Ezekiel et al., 2022). As shown in Figure 3, inverted five-spots and circular horizontal well patterns are two design options that have been investigated in modeling studies (Garapati et al., 2015; Adams et al., 2021a, 2021b; Randolph and Saar, 2011). The inverted five-spot configuration uses a center injection well, surrounded by four production wells. The circular horizontal configuration also has a center injection well but uses a circular collection well strategy that allows for broader heat capture. To fully realize the potential of the technology, it will be necessary to tailor the engineering and design of the wells, well pattern, and power plant

system to the physical characteristics of the reservoir, as well as understand the thermodynamics of the mixtures of CO<sub>2</sub> with resident brine and how CO<sub>2</sub>-water-rock interactions may impact long-term reservoir management strategies.

As the subsurface reservoir may be filled with brine at the outset of a new CO<sub>2</sub>-geothermal project or contain residual brine if CO<sub>2</sub> has already been emplaced for GCS, the co-production of water and CO<sub>2</sub> in the production well may occur. Such co-production may promote corrosion in the well tubing and casing due to the acidic nature of the mixture, however, internal anticorrosion materials that are commonly used in the oil and gas industry may limit potential corrosion to be negligible (Cui et al., 2021a, 2021b). Numerical modeling has shown that production well design and managing pressure drawdown in the reservoir can limit water upconing in the production well (Ezekiel et al., 2022). Still, avoiding aqueous-free-phase-CO<sub>2</sub> mixtures in the thermosiphon may be challenge, and wet CO<sub>2</sub> (CO<sub>2</sub> with dissolved H<sub>2</sub>O) may be produced, which can result in higher fluid temperatures and pressures at the production wellhead due to the exothermic exsolution of H<sub>2</sub>O from CO<sub>2</sub> (Fleming et al., 2020). The production of mixed fluids may reduce the thermosiphon effect because thermosiphons are stronger with the circulation of 100% CO<sub>2</sub> than of 100% H<sub>2</sub>O (Buscheck et al., 2014), but the higher temperatures and pressures can increase electric power output by 15–25% compared to dry CO<sub>2</sub> (Fleming et al., 2020). Furthermore, if other acid gases are present in the injected CO<sub>2</sub> or the aquifer there will be additional challenges related to processing the produced CO<sub>2</sub> at the surface. Changes in reservoir petrophysical properties due to CO<sub>2</sub>-water-rock interactions may affect heat mining, but reservoir simulations suggest that salt precipitation with continuous CO<sub>2</sub> injection may have more effect than geochemical reactions (Cui et al., 2018, 2021a, 2021b, 2018). Sedimentary formations can have heterogeneities in porosity, permeability, mineralogy, thickness, and other parameters, yet aside from one study on a multi-layered reservoir (Garapati et al., 2014), modeling to date has assumed homogeneous reservoirs with no variation in these reservoir properties. Because the geological heterogeneity of a reservoir can have a substantial impact on flow, productivity, and heat mining, investigating more complex systems in the context of geothermal heat extraction is a ripe area for research.

## CO<sub>2</sub> BULK ENERGY STORAGE: THE STATE OF THE TECHNOLOGY

The combination of GCS and geothermal energy production can be designed to facilitate grid-scale energy storage. Such a CO<sub>2</sub> bulk energy storage (CO<sub>2</sub>-BES) system could enable the deployment and utilization of high penetrations of variable wind and solar energy capacity. The original version of CO<sub>2</sub>-BES was dubbed the “Earth Battery” (Buscheck, 2015). The Earth Battery combines sedimentary basin CO<sub>2</sub>-geothermal with brine is production from the reservoir to manage pressure build-up from CO<sub>2</sub> injection and reduce the associated risks. In a sedimentary basin geothermal resource, the produced brine will be hot and could be used to generate electricity. With CO<sub>2</sub>-BES, electricity on the grid is used to compress, inject, and re-inject CO<sub>2</sub> (and brine) into deep saline aquifers. Demand for this electricity could be timed to use excess wind and solar generation that would otherwise be curtailed. The compressibility of CO<sub>2</sub> provides exceptional energy storage capacity and CO<sub>2</sub> can function as a cushion gas (Buscheck et al., 2016). In this application, CO<sub>2</sub> would initially need to displace large quantities of brine, and then the brine and CO<sub>2</sub> injection/production would be managed for pressure containment. When electricity is needed, the pressurized and geothermally-heated CO<sub>2</sub> and brine can be produced from the reservoir to generate electricity. Of the total capacity of CO<sub>2</sub>-BES designs with concentric rings and brine and CO<sub>2</sub> power cycles, as much as 93% of the total capacity is due to the brine cycle (Ogland-Hand et al., 2021). Further, the geothermal heat extraction can result in round-trip efficiencies much greater than 100%.

A CO<sub>2</sub>-BES facility can be flexible and operate as energy storage, GCS, and a geothermal power plant (Ogland-Hand et al., 2021). The approach can thus firm variable wind- and solar-generated electricity and compensate for diurnal and weekly fluctuations in electricity demand, like those shown in Figure 1 (Ogland-Hand et al., 2019). This flexibility could also yield a more cost-effective utilization of transmission lines and greater power system reliability. As a result, CO<sub>2</sub>-BES could be implemented to accommodate regional differences in renewable resource availability and electricity demand (Ogland-Hand et al., 2021), thereby enabling the displacement of fossil fuel-based generation across regional electricity systems. There are opportunities for this displacement to result in system-wide reductions in CO<sub>2</sub> emissions or water requirements but, as with other bulk energy storage approaches, such improvements in environmental outcomes are highly case-dependent (Ogland-Hand et al., 2019; Ryan et al., 2018; Hittinger and Azevedo, 2015).

Overall, CO<sub>2</sub>-BES has promise, but more research is needed to better understand how to design and operate such systems—including the impacts of the choice of power cycle and its integration with the characteristics of the reservoir—to achieve financial viability. Initial studies of generic designs of CO<sub>2</sub>-BES systems (i.e., not tailored to the geologic setting or the needs of the regional electricity system) estimate break-even compensation between \$8/tCO<sub>2</sub> and \$11/tCO<sub>2</sub> (Bielicki et al., 2021). This range is much lower than most estimates for the social cost of CO<sub>2</sub>, suggesting that these systems would offer positive net benefits to society. Other designs that use transcritical and supercritical CO<sub>2</sub> in two-reservoir systems have been shown to have larger energy storage densities than compressed air energy storage (the only other subsurface bulk energy storage approach) (Liu et al., 2016). Although the use of compressed transcritical CO<sub>2</sub> for energy storage results in higher efficiencies and energy storage densities, these systems are more complex, require a much shallower low-pressure reservoir, and have yet to have their environmental performance investigated.

For CO<sub>2</sub>-BES to be widely deployed, it will need to compete successfully against other energy storage options, such as pumped hydro storage and batteries. Pumped hydro storage is a mature technology that has been used for decades, but it requires suitable surface topography, elevation change, and reservoir capacity. The lack of availability of these factors limits the development of new projects. CO<sub>2</sub>-BES has a synergy with GCS and can be located in areas that are not suitable for pumped hydro storage. Recent advances in lithium-ion batteries, as well as favorable public policies, have led to a rapidly increasing number of utility-scale projects. Current projects, however, have limited discharge duration of at most 10 h of storage (Ma et al., 2018) and continued expansion of batteries may introduce material supply chain constraints. Subsurface energy storage technologies like CO<sub>2</sub>-BES are unlikely to rely on materials that are in limited supply, and offer the potential to provide long duration energy storage to compensate for regional and seasonal differences in variable renewable energy resources (Sepulveda et al., 2021).

### THE POSSIBILITY FOR SEDIMENTARY BASIN CO<sub>2</sub>-GEOTHERMAL AND CO<sub>2</sub>-BES TO PROVIDE GIGATON REDUCTIONS IN CO<sub>2</sub> AND GIGAWATTS OF POWER TO THE GRID


Even with rapid rates of decarbonization, gigatons of CO<sub>2</sub> will still be emitted in the coming years. Sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES are well suited to geologically store and utilize that CO<sub>2</sub>, while providing valuable power system services that can offer the flexibility to integrate higher penetrations of variable renewables. Figure 4 provides an illustrative scenario to convey the potential scale of CO<sub>2</sub> emissions mitigation and power generation from these technologies.

In this scenario, the US power system is assumed to be fully decarbonized by 2035, consistent with goals expressed by the Biden Administration (The White House, 2021), which is achieved through a linear reduction of fossil fueled generation while not retiring existing hydropower, nuclear, and renewable capacity. In addition, 20 GW/yr of new wind power, with an average capacity factor of 35%, and 30 GW/yr of solar power, with an alternating current (AC) capacity factor of 23%, are added. These capacity additions exceed the maximum historical annual values by roughly 50% (Bolinger et al., 2020; Wisser et al., 2020). This scenario also assumes modest load growth consistent with electrification of 25% of light duty vehicle miles traveled. As shown in Figure 4A, wind and solar generation would contribute over half (54%) of the generation in 2035, which presents challenges in reliably operating the grid in all hours. Approximately 800 TWh are provided by undesignated carbon-free generation sources (“other”), which would likely need to provide the grid balancing services needed to integrate wind and solar power. Sedimentary basin CO<sub>2</sub>-geothermal would be well-suited to contribute to help meet this gap.

To estimate the potential impacts of sedimentary basin CO<sub>2</sub>-geothermal, Figure 4B shows the effect of five 100-MW plants becoming operational each year over ten years (i.e., totaling 5,000 MW). These power plants are assumed to have a 65% capacity factor (similar to natural gas combined cycle plants) to facilitate load following while still offering significant generation.

Although this scenario represents a rapid transition away from fossil fuel-based electricity production, the power sector still emits 1.4 GtCO<sub>2</sub> in 2021, and 10.2 GtCO<sub>2</sub> between 2021 and 2035. Such a draw-down period provides an opportunity for sedimentary basin CO<sub>2</sub>-geothermal, which requires substantial quantities of CO<sub>2</sub> to “prime” the reservoirs before electricity can be generated (Ezekiel et al., 2022). Figure 4D shows the effect of priming each reservoir with 30 MtCO<sub>2</sub>/yr for three years (based on Garapati et al., 2015).



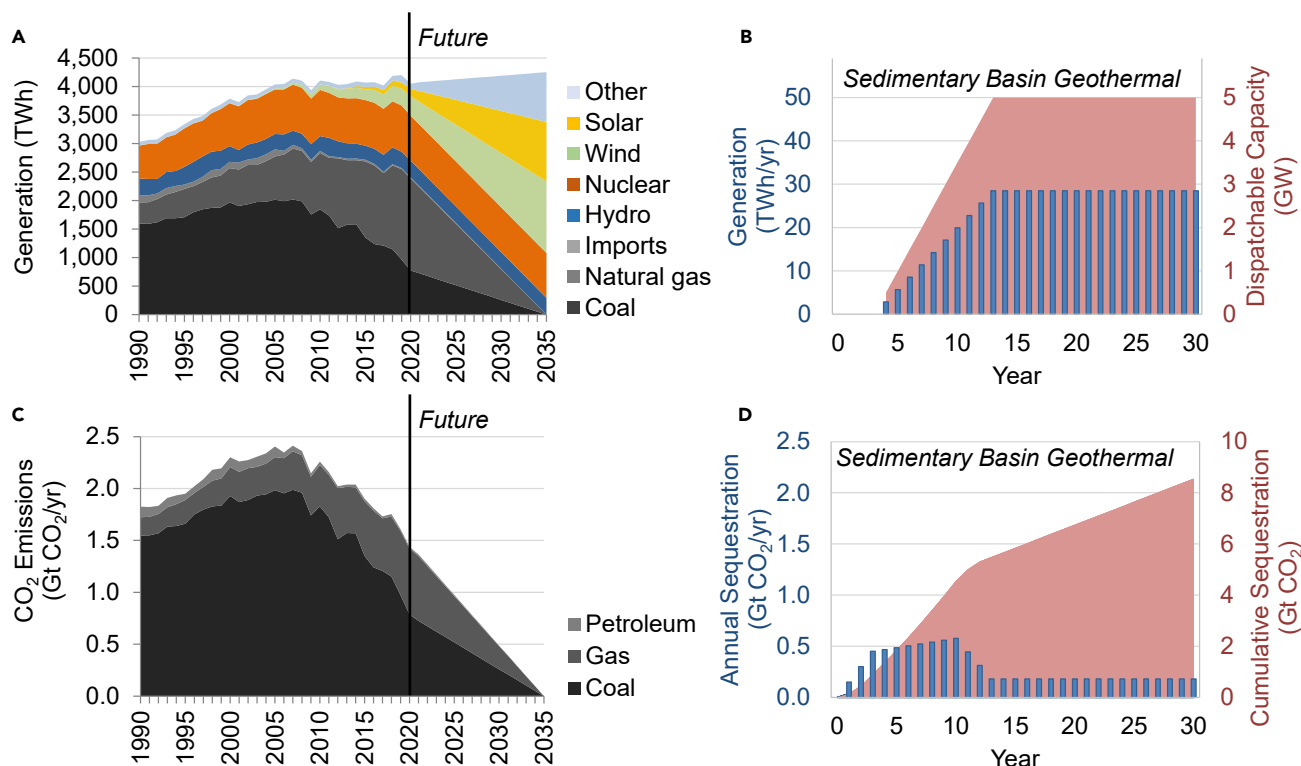

**Figure 4. A simple scenario to illustrate rapid decarbonization of the power sector in the United States and the potential for sedimentary geothermal to geologically store CO<sub>2</sub> while providing power system benefits**

(A) The mix of generation sources, (B) the estimated generation and firm capacity provided by fifty 100-MW sedimentary basin geothermal plants, (C) the power-sector CO<sub>2</sub> emissions from the combustion of fossil fuels, (D) the annual and cumulative CO<sub>2</sub> sequestered by the sedimentary basin geothermal plants.

Power generation commences afterward, with 4% of the CO<sub>2</sub> being replenished each year to accommodate losses in the reservoir.

Through this simple scenario, we show that these 50 sedimentary basin CO<sub>2</sub>-geothermal facilities would help reduce greenhouse gas emissions through three mechanisms. First, they would geologically store 8 GtCO<sub>2</sub> over 30 years. Second, they would generate more than 600 TWh of renewable carbon-free electricity. Third, their 5 GW of capacity would be operated flexibly to help reliably integrate high penetrations of wind and solar power. As shown, the magnitude of GCS could be quite large relative to overall CO<sub>2</sub> emissions. The flexible power system capacity could also enable and support the integration of a substantial amount of variable renewable energy capacity. The direct generation from sedimentary basin CO<sub>2</sub>-geothermal would be more modest in magnitude relative to more mature generation technologies, but still provide utility-scale levels of megawatt-hours.

Constructing 50 sedimentary basin CO<sub>2</sub>-geothermal plants in 12 years (i.e., five GW of new firm capacity) would be an impressive scale-up, but such a rate of deployment is consistent with the trajectories of other energy infrastructure, including the construction of power generating capacity, wells, and pipelines. Wind power in the United States increased from 2.5 GW in 2000 to over 60 GW by 2012 and 122 GW in 2020 (Wiser et al., 2020) and moved from a minor contributor to one of the largest sources of new electricity on the grid. Although it is a more mature technology, 228 GW of natural gas generation capacity were added to the U.S. electricity grid between 2002 and 2016. With respect to the pace of drilling, there was a substantial increase in development of unconventional shale resources in the United States, which resulted in the addition of approximately 150,000 horizontal wells between 2005 and 2020. The United States also added over 1,000 miles of CO<sub>2</sub> pipelines between 2007 and 2020. Although each of these technologies is unique,

the expansion of wind and natural gas generation, large-scale drilling, and pipeline construction demonstrate that rapid growth of energy infrastructure is possible under the right conditions.

Given the salient need for clear and sufficient policy and economic incentives to realize CO<sub>2</sub> emission reduction targets, sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES provide unique opportunities to couple an increase in carbon-free electricity generation with GCS. Sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES have the potential to be widely deployed at a scale sufficient to address the magnitude of the climate change challenge. Although neither technology has achieved wide commercial adoption, their development is sufficiently advanced such that near-term deployment is plausible and widespread adoption could be achieved in a time frame that matches the urgency of action needed for climate change.

### **SEDIMENTARY BASIN CO<sub>2</sub>-GEOTHERMAL AND CO<sub>2</sub>-BES WILL BE ENABLED BY A BROAD SET OF POLICIES AND MARKETS THAT SUPPORT RENEWABLE ENERGY, ENERGY STORAGE, CARBON MITIGATION, AND GEOLOGIC CO<sub>2</sub> STORAGE**

The policy landscape that affects sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES is complex, due in part to the range of services that they can provide. This section identifies how the development and deployment of these technologies can be accelerated through renewable energy mandates and incentives, energy storage requirements and market design, CO<sub>2</sub> taxes and emissions caps, and incentives for GCS. Differences in policies and market designs across countries and regions, in addition to the interactions and cumulative effects of relevant policies, will be consequential to the pace of demonstration and deployment.

Sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES could be used to satisfy renewable energy mandates and benefit from renewable energy incentives, which have accelerated the deployment of wind and solar power capacity. In the United States, geothermal energy is broadly accepted in the state-level Renewable Portfolio Standards, which typically require that a percentage of electricity sales are provided eligible renewable energy technologies. Currently, 30 states and the District of Columbia have these mandates, which will require an estimated 630 TWh of generation by renewable sources by 2030 (Barbose, 2021). Similarly, the European Union's Energy Directive required 20% renewable energy by 2020, and growth to 32% by 2030 (and there are proposals to raise that target) (European Commission, 2021). In China, central planning resulted in rapid expansion of renewable generation capacity, provincial renewable obligations, and recent efforts to reduce renewable energy curtailment (Hove, 2020). Geothermal is also eligible for US federal subsidies, including the Investment Tax Credit and Production Tax Credit (NC Clean Energy Technology Center, 2021). Although sedimentary basin geothermal broadly meets the requirements for this suite of policies, it would also be appropriate to include CO<sub>2</sub>-BES when geothermal heat extraction yields roundtrip efficiencies greater than 100%.

Numerous incentives, mandates, and favorable market structures for grid-scale energy storage are emerging, due to the value of its dispatchability and the declining costs of batteries, which could further the development and deployment of CO<sub>2</sub>-BES. After California's pioneering energy storage mandate in 2013, five other US states have adopted energy storage mandates or targets by 2021 (U.S. DOE Energy Information Administration, 2021). In 2018, US regulators required power system operators to remove barriers for energy storage participation in energy, capacity, and ancillary services markets, with the expectation that tariffs will reflect the value of the services that storage can provide. (FERC, 2018) Given its potential for scale and performance, it is possible that CO<sub>2</sub>-BES could help meet these energy storage mandates and participate in suitably designed power markets. The flexibility of CO<sub>2</sub>-BES to operate as an energy storage system, a generation source, or both can result in challenges in appropriately compensating for services. The recognition of multiple value streams, some of which may be regulated while others are in competitive markets (Forrester et al., 2017), is essential for properly compensating the services provided by CO<sub>2</sub>-BES.

Pricing CO<sub>2</sub> emissions, through a CO<sub>2</sub> tax or a cap-and-trade program (Aldy and Stavins, 2012), could benefit GCS as well as sedimentary basin CO<sub>2</sub> geothermal and CO<sub>2</sub>-BES. Because CO<sub>2</sub> would be permanently stored with some of it circulated as a heat extraction fluid, the sale of CO<sub>2</sub> offsets or the generation of credits could provide revenue. In addition, incurring another cost when emitting CO<sub>2</sub> would disadvantage coal and natural gas-fired generation relative to geothermal generation. There are dozens of these market-based mechanisms worldwide, spanning regional, national, and subnational jurisdictions. For example, the European Union implemented an emissions trading system in 2005, which has grown considerably since



then (The World Bank, 2021). In the United States, there are two major subnational CO<sub>2</sub> trading programs: (1) A cap-and-trade program in the state of California and (2) the Regional Greenhouse Gas Initiative that includes the Northeast and Mid-Atlantic states (Stavins, 2021). Although leakage from properly sited GCS reservoirs of any consequence (e.g., exceeds the US Department of Energy Storage Permanence goal (U.S. DOE, 2021)), is extremely improbable over operational lifetimes (Bielicki et al., 2015, 2016) and hundreds and thousands of years thereafter (IPCC et al., 2005; Pawar et al., 2015), sedimentary basin CO<sub>2</sub>-geothermal or CO<sub>2</sub>-BES operators would likely be required to conform to regulations governing GCS. For example, in the United States, the Environmental Protection Agency requires the GCS operator to monitor a GCS site for 50 years, or an alternative negotiated timeframe, after plugging the injection well before fully closing the site (U.S., Environmental Protection Agency, 2016).

Other policy instruments support GCS and are relevant for sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES. For example, the US 45Q federal tax credit enhanced by the Inflation Reduction Act of 2022 (Yarmuth, 2022) provides incentives for the emplacement of CO<sub>2</sub> into geologic reservoirs (U.S. Department of Treasury, 2021; Esposito et al., 2019). The minimum amount of CO<sub>2</sub> captured depends on the type of facility, and the date-in-service of the equipment, and the value of the tax credit depends on the use of the CO<sub>2</sub>: GCS, CO<sub>2</sub>-enhanced oil recovery, or CO<sub>2</sub> utilization. For example, electric generating units with equipment placed in service on after December 31, 2022 must capture at least 18,750 tCO<sub>2</sub>/y to be eligible for the credit, and can receive up \$85/tCO<sub>2</sub> for GCS. Direct air CO<sub>2</sub> capture (DAC), and other facilities can have lower annual capture requirements (1,000 tCO<sub>2</sub>/y), and CO<sub>2</sub>-enhanced oil recovery and other types of CO<sub>2</sub> utilization may receive a tax credit up to \$60/tCO<sub>2</sub>. The Inflation Reduction Act of 2022 increases also 45Q credit values for any capture equipment placed in service after December 31, 2022 to \$180/tCO<sub>2</sub> for DAC facilities that store CO<sub>2</sub> in saline geologic formations, \$130/tCO<sub>2</sub> for DAC-utilization, and \$130/tCO<sub>2</sub> for DAC-EOR storage (Yarmuth, 2022).

The present structure has a \$25/tCO<sub>2</sub> difference between credits for storage and for utilization, but this difference increases to \$50/tCO<sub>2</sub> when the capture equipment is DAC. This is insufficient to encourage significant investment in direct storage and thus favors utilization projects such as CO<sub>2</sub>-EOR or DAC-EOR that are profit generating. Sedimentary basin CO<sub>2</sub> geothermal and CO<sub>2</sub>-BES would likely receive the utilization tax credit because they produce an economically valuable good (heat, electricity, and grid services), which can help recover fixed costs. In addition, those technologies can rely on a variety of sources for the CO<sub>2</sub> working fluid, but the ownership of the capture equipment influences the value of this tax credit. Specifically, tax credits could be claimed by the taxpayer owning the equipment to capture the CO<sub>2</sub>, and the ability to monetize the tax credit with a third party opens new businesses for electricity companies, sedimentary basin CO<sub>2</sub>-geothermal, and CO<sub>2</sub>-BES systems.

Here, we described a variety of policies intended to spur renewable energy development, CO<sub>2</sub> emissions mitigation, and GCS, all of which could incentivize the development of sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES. Because of this broad array of policies, these technologies may be able to collect multiple revenue streams and compete well against more mature technologies. In addition, sedimentary basin CO<sub>2</sub>-geothermal can engender learning and reduce costs for GCS.

## OVERCOMING THE OBSTACLES TO WIDESPREAD DEPLOYMENT

To achieve widespread deployment of sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES several challenges should be considered, including technical, economic, and social issues that the GCS community has been examining extensively since the early 2000s. Examples specific to GCS include: preventing and monitoring CO<sub>2</sub> leakage from the target reservoir (Vialle et al., 2018); predicting subsurface flow of injected CO<sub>2</sub> (Nordbotten et al., 2005a, 2005b); CO<sub>2</sub> source-sink matching and transmission pipeline buildout (Bielicki et al., 2018); ensuring wellbore and pipeline integrity (Crow et al., 2010; Onyebuchi et al., 2018); public perception and acceptance (L'Orange Seigo et al., 2014); regulatory requirements, risk management, and long-term liability (Bielicki et al., 2016; Anderson, 2017; Dixon et al., 2015); inconsistent or absent markets that price CO<sub>2</sub> emissions (Aldy and Stavins, 2012); and economic competitiveness with other GHG mitigation approaches (Budinis et al., 2018; Lilliestam et al., 2012). Although these challenges also apply to sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES, the goal of this perspective piece is to highlight the potential for combining GCS with renewable energy production and explore the unique challenges facing this new application of GCS. Some challenges that may be specific to these new technologies include controlling plume migration to allow for continuous CO<sub>2</sub> injection and extraction; ensuring efficient brine

displacement and CO<sub>2</sub> heat sweep efficiency; and achieving CO<sub>2</sub> source-sink matching for non-continuous or non-uniform CO<sub>2</sub> injection demand. In addition, the success of these technologies is contingent on alignment of public policies, the availability of key incentives and participation in markets, and achieving public acceptance of large-scale projects. Although our simple scenario clearly demonstrates the potential of these technologies to enable significant decarbonization, there are several areas of research which, if well addressed, would help overcome the most pressing challenges. Here, we list seven outstanding multi-disciplinary research questions:

Major gaps in knowledge for sedimentary basin CO<sub>2</sub>-Geothermal and CO<sub>2</sub>-BES

1. What are the impacts on (multi-phase) fluid and energy flow due to geological heterogeneity at scales ranging from hydrostratigraphic layering to the pore scale and how do these impacts affect sedimentary basin CO<sub>2</sub>-geothermal and CO<sub>2</sub>-BES? Can the reservoir variability be leveraged to benefit the technologies?
2. What reservoir management strategies should be pursued to optimize the benefits of multi-decadal heat extraction?
3. What are the best deployment and operational strategies in light of decreasing sources of CO<sub>2</sub> and increasing penetrations of variable renewable energy on the grid?
4. How can life cycle assessment techniques be used to estimate the levels of decarbonization more accurately and determine the parameters that most greatly influence those outcomes?
5. What levels of incentives are necessary to encourage the growth of this industry and what conditions on these incentives would ensure the greatest levels of decarbonization?
6. What influences public support or opposition to the use of CO<sub>2</sub> for producing geothermal energy and how might this affect the technology deployment?
7. What are the technical and legal issues surrounding large-scale implementation of these technologies such as pressure or groundwater level changes extending over multiple pore-space owners across the whole basin?

Subsurface heterogeneity can play an important role in heat transfer, but these issues are not fully understood and could impact the performance of facilities. Candidate aquifers in sedimentary basins can have unconformities in three dimensions and the permeability, for example, can vary by several orders of magnitude over a few meters in all directions. The existence of such heterogeneity can create “thief zones” of higher permeability, with higher mass flow rates (and thus more heat extraction with if there is sufficient residence time in the reservoir), or regions with lower permeability that can restrict flow rates, increase pore pressure, and negatively impact heat extraction efficiency. At the reservoir-scale, there are important, but unanswered questions regarding optimal rates of heat extraction. There is incomplete understanding of the ongoing CO<sub>2</sub> replenishment rates required to maintain geothermal power generation levels, which could present opportunities for additional GCS or challenges in maintaining geothermal energy production, depending on the access to CO<sub>2</sub> supplies. To date, these reservoir characteristics and the subsequent effects on the operational costs of energy production and roundtrip efficiencies of energy storage have not been considered. All of these issues, and more, exist within uncertain long-term CO<sub>2</sub> mitigation measures and in the context of evolving power systems that are subject to changing regulatory, policy, and business landscapes. If these obstacles are overcome, these technologies could provide gigaton-level CO<sub>2</sub> mitigation and gigawatt-level power system services.

## ACKNOWLEDGMENTS

We gratefully acknowledge funding from the Alfred P. Sloan Foundation’s Net-Zero and Negative Emissions Technologies program (Grant No. 2020–12,466). BRE also acknowledges partial funding support from the National Science Foundation (Grant No. 1943726).

## DECLARATION OF INTERESTS

The authors declare no competing interests.

## REFERENCES

- Adams, B.M., Kuehn, T.H., Bielicki, J.M., Randolph, J.B., and Saar, M.O. (2014). On the importance of the thermosiphon effect in CPG (CO<sub>2</sub> plume geothermal) power systems. *Energy* 69, 409–418. <https://doi.org/10.1016/j.energy.2014.03.032>.
- Adams, B.M., Kuehn, T.H., Bielicki, J.M., Randolph, J.B., and Saar, M.O. (2015). A comparison of electric power output of CO<sub>2</sub> plume geothermal (CPG) and brine geothermal systems for varying reservoir conditions. *Appl. Energy* 140, 365–377. <https://doi.org/10.1016/j.apenergy.2014.11.043>.
- Adams, B.M., Fleming, M.R., Bielicki, J.M., Garapati, N., and Saar, M.O. (2021a). An analysis of the demonstration of a CO<sub>2</sub>-based thermosiphon at the SECARB cranfield site. In *PROCEEDINGS, 46th Workshop on Geothermal Reservoir Engineering*, pp. 1–9.
- Adams, B.M., Vogler, D., Kuehn, T.H., Bielicki, J.M., Garapati, N., and Saar, M.O. (2021b). Heat depletion in sedimentary basins and its effect on the design and electric power output of CO<sub>2</sub> Plume Geothermal (CPG) systems. *Renew. Energy* 172, 1393–1403. <https://doi.org/10.1016/j.renene.2020.11.145>.
- Aldy, J.E., and Stavins, R.N. (2012). The promise and problems of pricing carbon: theory and experience. *J. Environ. Dev.* 21, 152–180. <https://doi.org/10.1177/1070496512442508>.
- Anderson, S.T. (2017). Risk, liability, and economic issues with long-term CO<sub>2</sub> storage—a review. *Nat. Resour. Res.* 26, 89–112. <https://doi.org/10.1007/s11053-016-9303-6>.
- Arbabszadeh, M., Siohansi, R., Johnson, J.X., and Keoleian, G.A. (2019). The role of energy storage in deep decarbonization of electricity production. *Nat. Commun.* 10, 3413. <https://doi.org/10.1038/s41467-019-11161-5>.
- Atrens, A.D., Gurgenci, H., and Rudolph, V. (2009). CO<sub>2</sub> thermosiphon for competitive geothermal power generation. *Energy Fuels* 23, 553–557.
- Atrens, A.D., Gurgenci, H., and Rudolph, V. (2010). Electricity generation using a carbon-dioxide thermosiphon. *Geothermics* 39, 161–169. <https://doi.org/10.1016/j.geothermics.2010.03.001>.
- Barbose, G. (2021). *U.S. Renewables Portfolio Standards 2021 Status Update: Early Release*.
- Bielicki, J.M., Peters, C.A., Fitts, J.P., and Wilson, E.J. (2015). An examination of geologic carbon sequestration policies in the context of leakage potential. *Int. J. Greenh. Gas Control* 37, 61–75. <https://doi.org/10.1016/j.jggc.2015.02.023>.
- Bielicki, J.M., Pollak, M.F., Deng, H., Wilson, E.J., Fitts, J.P., and Peters, C.A. (2016). The leakage risk monetization model for geologic CO<sub>2</sub> storage. *Environ. Sci. Technol.* 50, 4923–4931. <https://doi.org/10.1021/acs.est.5b05329>.
- Bielicki, J.M., Langenfeld, J.K., Tao, Z., Middleton, R.S., Menefee, A.H., and Clarens, A.F. (2018). The geospatial and economic viability of CO<sub>2</sub> storage in hydrocarbon depleted fractured shale formations. *Int. J. Greenh. Gas Control* 75, 8–23. <https://doi.org/10.1016/j.jggc.2018.05.015>.
- Bielicki, J.M., Adams, B.M., Miranda, M.M., Choi, H., Jamiyansuren, B., Taff, S.J., Buscheck, T.A., Ogland-Hand, J., and Saar, M.O. (2021). Engineering cost-competitive electricity from geologic CO<sub>2</sub> storage reservoirs. *Energy Convers. Manag. In Revisio.*
- Bolinger, M., Seel, J., Robson, D., and Warner, C. (2020). *Utility-Scale Solar Data Update: 2020 Edition*.
- Braff, W.A., Mueller, J.M., and Trancik, J.E. (2016). Value of storage technologies for wind and solar energy. *Nat. Clim. Chang.* 6, 964–969. <https://doi.org/10.1038/nclimate3045>.
- Breede, K., Dzebisashvili, K., Liu, X., and Falcone, G. (2013). A systematic review of enhanced (or engineered) geothermal systems: past, present and future. *Geotherm. Energy* 1, 4. <https://doi.org/10.1186/2195-9706-1-4>.
- Brown, D.W. (2000). A hot dry rock geothermal energy concept utilizing CO<sub>2</sub> instead of water. In *PROCEEDINGS: Twenty-Fifth Workshop on Geothermal Reservoir Engineering*, pp. 1–6.
- Budinis, S., Krevor, S., Dowell, N.M., Hawkes, A., and Brandon, N. (2018). An assessment of CCS costs, barriers and potential. *Energy Strategy Rev.* 22, 61–81. <https://doi.org/10.1016/j.esr.2018.08.003>.
- Buscheck, T.A., Sun, Y., Chen, M., Hao, Y., Wolery, T.J., Bourcier, W.L., Court, B., Celia, M.A., Julio Friedmann, S., and Aines, R.D. (2012). Active CO<sub>2</sub> reservoir management for carbon storage: analysis of operational strategies to relieve pressure buildup and improve injectivity. *Int. J. Greenh. Gas Control* 6, 230–245. <https://doi.org/10.1016/j.jggc.2011.11.007>.
- Buscheck, T.A., Bielicki, J.M., Randolph, J.B., Chen, M., Hao, Y., Edmunds, T.A., Adams, B.M., and Sun, Y. (2014). Multi-fluid geothermal energy systems in stratigraphic reservoirs: using brine, N<sub>2</sub>, and CO<sub>2</sub> for dispatchable renewable power generation and bulk energy storage. In *Proceedings of the 39th Workshop on Geothermal Reservoir Engineering*.
- Buscheck, T.A. (2015). Earth Battery. *Mech. Eng.* 137, 36–41. <https://doi.org/10.1115/1.2015-Dec-2>.
- Buscheck, T.A., Bielicki, J.M., Edmunds, T.A., Hao, Y., Sun, Y., Randolph, J.B., and Saar, M.O. (2016). Multifluid geo-energy systems: using geologic CO<sub>2</sub> storage for geothermal energy production and grid-scale energy storage in sedimentary basins. *Geosphere* 12, 678–696. <https://doi.org/10.1130/GES01207.1>.
- Crow, W., Carey, J.W., Gasda, S., Brian Williams, D., and Celia, M. (2010). Wellbore integrity analysis of a natural CO<sub>2</sub> producer. *Int. J. Greenh. Gas Control* 4, 186–197. <https://doi.org/10.1016/j.jggc.2009.10.010>.
- Cui, G., Ren, S., Rui, Z., Ezekiel, J., Zhang, L., and Wang, H. (2018). The influence of complicated fluid-rock interactions on the geothermal exploitation in the CO<sub>2</sub> plume geothermal system. *Appl. Energy* 227, 49–63. <https://doi.org/10.1016/j.apenergy.2017.10.114>.
- Cui, G., Pei, S., Rui, Z., Dou, B., Ning, F., and Wang, J. (2021a). Whole process analysis of geothermal exploitation and power generation from a depleted high-temperature gas reservoir by recycling CO<sub>2</sub>. *Energy* 217, 119340. <https://doi.org/10.1016/j.energy.2020.119340>.
- Cui, G., Ren, S., Dou, B., and Ning, F. (2021b). Geothermal energy exploitation from depleted high-temperature gas reservoirs by recycling CO<sub>2</sub>: the superiority and existing problems. *Geosci. Front.* 12, 101078. <https://doi.org/10.1016/j.gsf.2020.08.014>.
- Das, S., Hittinger, E., and Williams, E. (2020). Learning is not enough: diminishing marginal revenues and increasing abatement costs of wind and solar. *Renew. Energy* 156, 634–644. <https://doi.org/10.1016/j.renene.2020.03.082>.
- Davis, S.J., Lewis, N.S., Shaner, M., Aggarwal, S., Arent, D., Azevedo, I.L., Benson, S.M., Bradley, T., Brouwer, J., Chiang, Y.M., et al. (2018). Net-zero emissions energy systems. *Science* 360, eaas9793. <https://doi.org/10.1126/science.aas9793>.
- Deng, H., Bielicki, J.M., Oppenheimer, M., Fitts, J.P., and Peters, C.A. (2017). Leakage risks of geologic CO<sub>2</sub> sequestration and the impacts on the global energy system and climate mitigation. *Clim. Change* 144, 151–163. <https://doi.org/10.1007/s10584-017-2035-8>.
- Denholm, P., O'Connell, M., Brinkman, G., and Jorgenson, J. (2015). *Overgeneration from solar energy in California: a field guide to the duck chart (NREL/TP-6A20-65023)*. Tech. Rep. 46.
- Dixon, T., McCoy, S.T., and Havercroft, I. (2015). Legal and regulatory developments on CCS 40, 431–448. <https://doi.org/10.1016/j.jggc.2015.05.024>.
- Esposito, R.A., Kuuskraa, V.A., Rossman, C.G., and Corser, M.M. (2019). Reconsidering CCS in the US fossil-fuel fired electricity industry under section 45Q tax credits. *Greenhouse Gas. Sci. Technol.* 9, 1288–1301. <https://doi.org/10.1002/ghg.1925>.
- European Commission (2021). *Renewable Energy Directive*.
- Ezekiel, J., Ebigo, A., Adams, B.M., and Saar, M.O. (2020). Combining natural gas recovery and CO<sub>2</sub>-based geothermal energy extraction for electric power generation. *Appl. Energy* 269, 115012. <https://doi.org/10.1016/j.apenergy.2020.115012>.
- Ezekiel, J., Adams, B.M., Saar, M.O., and Ebigo, A. (2022). Numerical analysis and optimization of the performance of CO<sub>2</sub>-Plume Geothermal (CPG) production wells and implications for electric power generation. *Geothermics* 98, 102270. <https://doi.org/10.1016/j.geothermics.2021.102270>.
- FERC (2018). *Electric Storage Participation in Markets Operated by Regional Transmission Organizations and Independent System Operators (FERC)*.

- Fleming, M.R., Adams, B.M., Kuehn, T.H., Bielicki, J.M., and Saar, M.O. (2020). Increased power generation due to exothermic water exsolution in CO<sub>2</sub> plume geothermal (CPG) power plants. *Geothermics* 88, 101865. <https://doi.org/10.1016/j.geothermics.2020.101865>.
- Forrester, S.P., Zaman, A., Mathieu, J.L., and Johnson, J.X. (2017). Policy and market barriers to energy storage providing multiple services. *Electr. J.* 30, 50–56. <https://doi.org/10.1016/j.tej.2017.10.001>.
- Garapati, N., Randolph, J.B., Valencia, J.L., and Saar, M.O. (2014). CO<sub>2</sub>-Plume geothermal (CPG) heat extraction in multi-layered geologic reservoirs. *Energy Proc.* 63, 7631–7643. <https://doi.org/10.1016/j.egypro.2014.11.797>.
- Garapati, N., Randolph, J.B., and Saar, M.O. (2015). Brine displacement by CO<sub>2</sub>, energy extraction rates, and lifespan of a CO<sub>2</sub>-limited CO<sub>2</sub>-plume geothermal (CPG) system with a horizontal production well. *Geothermics* 55, 182–194. <https://doi.org/10.1016/j.geothermics.2015.02.005>.
- Garapati, N., Adams, B.M., Fleming, M.R., Kuehn, T.H., and Saar, M.O. (2020). Combining brine or CO<sub>2</sub> geothermal preheating with low-temperature waste heat: a higher-efficiency hybrid geothermal power system. *J. CO<sub>2</sub> Util.* 42, 101323. <https://doi.org/10.1016/j.jcou.2020.101323>.
- Global CCS Institute (2020). *Global Status of CCS: 2020* (Global CCS Institute), p. 44.
- Hittinger, E.S., and Azevedo, I.M.L. (2015). Bulk energy storage increases United States electricity system emissions. *Environ. Sci. Technol.* 49, 3203–3210. <https://doi.org/10.1021/es505027p>.
- IPCC (2005). In *IPCC Special Report on Carbon Dioxide Capture and Storage Prepared by B. Metz, O. Davidson, H. de Coninck, M. Loos, and L. Meyer, eds.* (Cambridge University Press).
- Hove, A. (2020). *Trends and Contradictions in China's Renewable Energy Policy*.
- IPCC (2021). *Summary for policymakers. In Climate Change 2021: The Physical Science Basis*, V. Masson-Delmotte, P. Zhai, A. Pirani, S.L. Connors, C. Péan, S. Berger, N. Caud, Y. Chen, L. Goldfarb, and M.I. Gomis, et al., eds. (Cambridge University Press), p. 41.
- Jenkins, J.D., Luke, M., and Thernstrom, S. (2018). Getting to zero carbon emissions in the electric power sector. *Joule* 2, 2498–2510. <https://doi.org/10.1016/j.joule.2018.11.013>.
- Krey, V., Luderer, G., Clarke, L., and Kriegler, E. (2014). Getting from here to there – energy technology transformation pathways in the EMF27 scenarios. *Clim. Change* 123, 369–382. <https://doi.org/10.1007/s10584-013-0947-5>.
- L'Orange Seigo, S., Dohle, S., and Siegrist, M. (2014). Public perception of carbon capture and storage (CCS): a review. *Renew. Sustain. Energy Rev.* 38, 848–863. <https://doi.org/10.1016/j.rser.2014.07.017>.
- Lilliestam, J., Bielicki, J.M., and Patt, A.G. (2012). Comparing carbon capture and storage (CCS) with concentrating solar power (CSP): potentials, costs, risks, and barriers. *Energy Pol.* 47, 447–455. <https://doi.org/10.1016/j.enpol.2012.05.020>.
- Liu, H., He, Q., Borgia, A., Pan, L., and Oldenburg, C.M. (2016). Thermodynamic analysis of a compressed carbon dioxide energy storage system using two saline aquifers at different depths as storage reservoirs. *Energy Convers. Manag.* 127, 149–159. <https://doi.org/10.1016/j.enconman.2016.08.096>.
- Ma, J., Li, Q., Kühn, M., and Nakaten, N. (2018). Power-to-gas based subsurface energy storage: a review. *Renew. Sustain. Energy Rev.* 97, 478–496. <https://doi.org/10.1016/j.rser.2018.08.056>.
- Majer, E.L., Baria, R., Stark, M., Oates, S., Bommer, J., Smith, B., and Asanuma, H. (2007). Induced seismicity associated with enhanced geothermal systems. *Geothermics* 36, 185–222. <https://doi.org/10.1016/j.geothermics.2007.03.003>.
- National Academies of Science Engineering and Medicine (2021). *Accelerating Decarbonization of the U.S. Energy System* (National Academies Press). <https://doi.org/10.17226/25932>.
- NC Clean Energy Technology Center (2021). *Database of State Incentives for Renewables & Electricity - DSIRE*.
- Nordbotten, J.M., Celia, M.A., and Bachu, S. (2005a). Injection and storage of CO<sub>2</sub> in deep saline aquifers: analytical solution for CO<sub>2</sub> plume evolution during injection. *Transp. Porous Media* 58, 339–360. <https://doi.org/10.1007/s11242-004-0670-9>.
- Nordbotten, J.M., Celia, M.A., Bachu, S., and Dahle, H.K. (2005b). *Semianalytical solution for CO<sub>2</sub> leakage through an abandoned well*. *Environ. Sci. Technol.* 39, 602–611.
- Ogland-Hand, J.D., Bielicki, J.M., Wang, Y., Adams, B.M., Buscheck, T.A., and Saar, M.O. (2019). The value of bulk energy storage for reducing CO<sub>2</sub> emissions and water requirements from regional electricity systems. *Energy Convers. Manag.* 181, 674–685. <https://doi.org/10.1016/j.enconman.2018.12.019>.
- Ogland-Hand, J.D., Bielicki, J.M., Adams, B.M., Nelson, E.S., Buscheck, T.A., Saar, M.O., and Sioshansi, R. (2021). The value of CO<sub>2</sub>-Bulk energy storage with wind in transmission-constrained electric power systems. *Energy Convers. Manag.* 228, 113548. <https://doi.org/10.1016/j.enconman.2020.113548>.
- Onyebuchi, V.E., Kolios, A., Hanak, D.P., Bilyok, C., and Manovic, V. (2018). A systematic review of key challenges of CO<sub>2</sub> transport via pipelines. *Renew. Sustain. Energy Rev.* 81, 2563–2583. <https://doi.org/10.1016/j.rser.2017.06.064>.
- Pan, L., Freifeld, B., Doughty, C., Zakem, S., Sheu, M., Cutright, B., and Terrall, T. (2015). Fully coupled wellbore-reservoir modeling of geothermal heat extraction using CO<sub>2</sub> as the working fluid. *Geothermics* 53, 100–113. <https://doi.org/10.1016/j.geothermics.2014.05.005>.
- Pan, L., Doughty, C., and Freifeld, B. (2018). How to sustain a CO<sub>2</sub>-thermosiphon in a partially saturated geothermal reservoir: lessons learned from field experiment and numerical modeling. *Geothermics* 71, 274–293. <https://doi.org/10.1016/j.geothermics.2017.10.004>.
- Pawar, R.J., Bromhal, G.S., Carey, J.W., Foxall, W., Korre, A., Ringrose, P.S., Tucker, O., Watson, M.N., and White, J.A. (2015). Recent advances in risk assessment and risk management of geologic CO<sub>2</sub> storage. *Int. J. Greenh. Gas Control* 40, 292–311. <https://doi.org/10.1016/j.ijggc.2015.06.014>.
- Qiao, Z., Cao, Y., Li, P., Wang, X., Romero, C.E., and Pan, L. (2020). Thermoeconomic analysis of a CO<sub>2</sub> plume geothermal and supercritical CO<sub>2</sub> Brayton combined cycle using solar energy as auxiliary heat source. *J. Clean. Prod.* 256, 120374. <https://doi.org/10.1016/j.jclepro.2020.120374>.
- Randolph, J.B., and Saar, M.O. (2011). Combining geothermal energy capture with geologic carbon dioxide sequestration. *Geophys. Res. Lett.* 38, 1–7. <https://doi.org/10.1029/2011GL047265>.
- Ryan, N.A., Lin, Y., Mitchell-Ward, N., Mathieu, J.L., and Johnson, J.X. (2018). Use-phase drives lithium-ion Battery life cycle environmental impacts when used for frequency regulation. *Environ. Sci. Technol.* 52, 10163–10174. <https://doi.org/10.1021/acs.est.8b02171>.
- Schultz, R., Skoumal, R.J., Brudzinski, M.R., Eaton, D., Bappte, B., and Ellsworth, W. (2020). Hydraulic fracturing-induced seismicity. *Rev. Geophys.* 58, 1–43. <https://doi.org/10.1029/2019RG000695>.
- SedHeat (2013). *Tracking an Energy Elephant: Science and Engineering Challenges for Unlocking the Geothermal Potential of Sedimentary Basins*.
- Sepulveda, N.A., Jenkins, J.D., de Sisternes, F.J., and Lester, R.K. (2018). The role of firm low-carbon electricity resources in deep decarbonization of power generation. *Joule* 2, 2403–2420. <https://doi.org/10.1016/j.joule.2018.08.006>.
- Sepulveda, N.A., Jenkins, J.D., Edington, A., Mallapragada, D.S., and Lester, R.K. (2021). The design space for long-duration energy storage in decarbonized power systems. *Nat. Energy* 6, 506–516. <https://doi.org/10.1038/s41560-021-00796-8>.
- Stavins, R.N. (2021). *Lessons Learned from Sub-National Emissions Trading Systems*.
- Tester, J.W., Anderson, B.J., Batchelor, A.S., Blackwell, D.D., DiPippo, R., Drake, E.M., Garnish, J., Livesay, B., Moore, M.C., Nichols, K., et al. (2006). *The Future of Geothermal Energy: Impact of Enhanced Geothermal Systems (EGS) in the United States in the 21st Century* (MIT Press).
- The White House (2021). *FACT SHEET: President Biden Sets 2030 Greenhouse Gas Pollution Reduction Target Aimed at Creating Good-Paying Union Jobs and Securing U.S. Leadership on Clean Energy Technologies*.
- U.S. Department of the Treasury (2021). *Credit for Carbon Oxide Sequestration* (Federal Register).
- U.S. DOE (2019). *GEO Vision: Harnessing the Heat Beneath Our Feet*.
- U.S. DOE (2021). *Carbon storage R&D*. Off. Foss. Energy Carbon Manag.
- U.S. DOE EERE (2021). *Geothermal FAQs*. Geotherm. Technol. Off.

U.S. DOE EIA (2021). Annual Energy Outlook 2021 with Projections to 2050.

U.S. DOE Energy Information Administration (2021). Battery storage in the United States: an update on market trends (U.S. Energy Information Administration), p. 37.

U.S. Environmental Protection Agency (2016). Geologic Sequestration of Carbon Dioxide Underground Injection Control (UIC) Program Class VI Well Plugging, PostInjection Site Care, and Site Closure Guidance.

S. Vialle, J.B. Ajo-Franklin, and J.W. Carey, eds. (2018). Geologic Carbon Sequestration:

Subsurface Seals and Caprock Integrity (American Geophysical Union Monograph Series).

Wang, X., Levy, E.K., Pan, C., Romero, C.E., Banerjee, A., Rubio-Maya, C., and Pan, L. (2019). Working fluid selection for organic rankine cycle power generation using hot produced supercritical CO<sub>2</sub> from a geothermal reservoir. *Appl. Therm. Eng.* 149, 1287–1304. <https://doi.org/10.1016/j.applthermaleng.2018.12.112>.

Williams, J.H., DeBenedictis, A., Ghanadan, R., Mahone, A., Moore, J., Morrow, W.R., Price, S., and Torn, M.S. (2012). The technology path to deep greenhouse gas emissions cuts by 2050: the

pivotal role of electricity. *Science* 335, 53–59. <https://doi.org/10.1126/science.1208365>.

Wiser, R.H., Bolinger, M., Hoen, B., Millstein, D., Rand, J., Barbose, G.L., Darghouth, N.R., Gorman, W., Jeong, S., Mills, A.D., et al. (2020). Wind Energy Technology Data Update: 2020 Edition.

The World Bank (2021). State and Trends of Carbon Pricing 2021. <https://doi.org/10.1596/978-1-4648-1728-1>.

Yarmuth, J.A. (2022). Inflation Reduction Act of 2022.